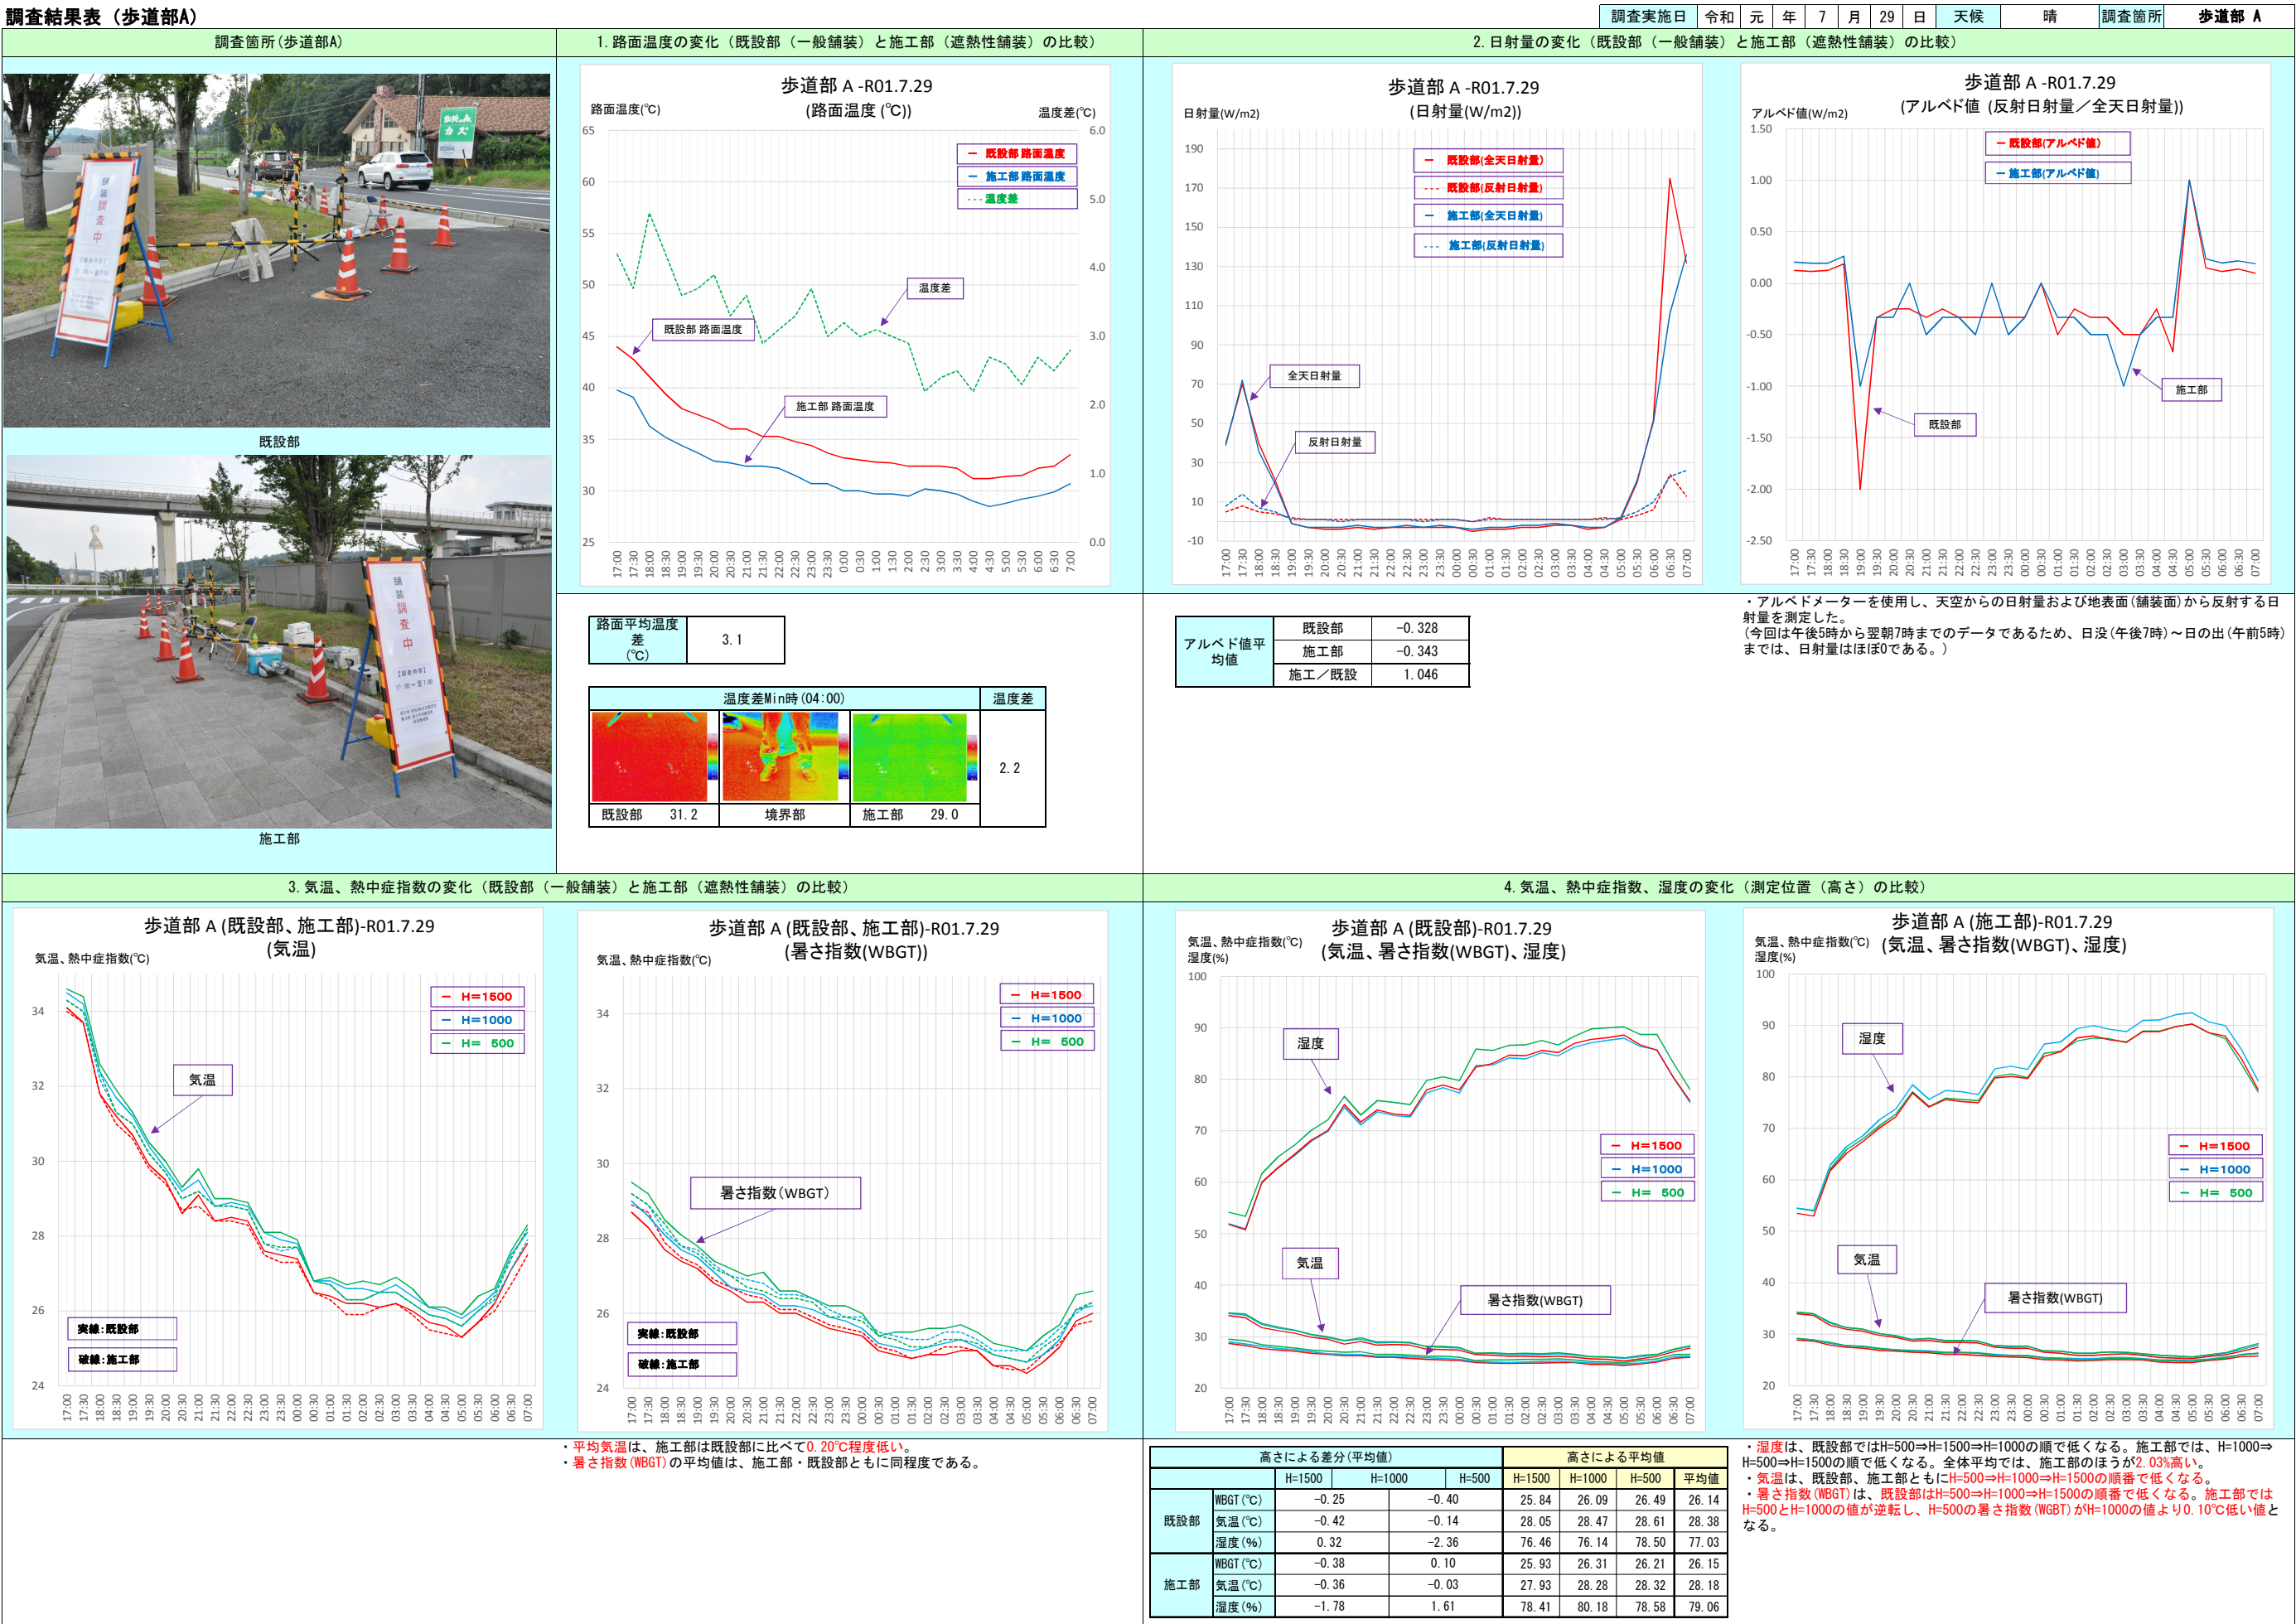


調査結果表（歩道部A）



測定箇所 歩道部A (既設部)

測定器No No. 1 H=1500

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)	H=1000との差		
	WBGT IN (°C)	WBGT OUT (°C)						WBGT OUT (°C)	気温 (°C)	相対湿度 (°C)
17:00	28.9	28.7	34.1	35.3	26.1	22.8	51.8	-0.3	-0.4	-0.2
17:30	28.5	28.3	33.7	35.2	25.6	22.1	50.8	-0.3	-0.5	-0.2
18:00	27.8	27.7	31.8	33.0	25.6	23.1	60.0	-0.4	-0.6	0.0
18:30	27.5	27.4	31.2	31.9	25.6	23.3	62.9	-0.3	-0.5	0.0
19:00	27.2	27.2	30.7	31.0	25.6	23.5	65.5	-0.3	-0.5	0.3
19:30	26.8	26.8	29.9	30.4	25.3	23.4	68.2	-0.3	-0.5	0.2
20:00	26.6	26.6	29.5	29.8	25.2	23.5	70.1	-0.1	-0.3	0.2
20:30	26.4	26.3	28.6	29.1	25.2	23.8	75.1	-0.3	-0.6	0.5
21:00	26.4	26.3	29.1	29.3	25.1	23.5	71.7	-0.2	-0.4	0.5
21:30	26.0	26.0	28.4	28.9	24.8	23.3	74.1	-0.2	-0.4	0.4
22:00	26.0	26.0	28.5	28.9	24.8	23.3	73.3	-0.2	-0.4	0.3
22:30	25.9	25.8	28.4	28.8	24.6	23.1	73.0	-0.3	-0.4	0.3
23:00	25.6	25.6	27.6	28.0	24.6	23.4	78.0	-0.3	-0.5	0.6
23:30	25.6	25.5	27.5	27.8	24.6	23.5	78.9	-0.3	-0.4	0.5
00:00	25.4	25.4	27.4	27.7	24.4	23.2	78.0	-0.2	-0.4	0.6
00:30	25.0	25.0	26.5	26.9	24.2	23.3	82.4	-0.2	-0.3	-0.3
01:00	24.9	24.9	26.4	26.5	24.2	23.3	83.1	-0.2	-0.4	0.3
01:30	24.8	24.8	26.2	26.3	24.2	23.4	84.7	-0.2	-0.4	0.5
02:00	24.9	24.9	26.2	26.6	24.2	23.4	84.6	-0.2	-0.4	0.6
02:30	24.9	24.9	26.1	26.6	24.2	23.5	85.6	-0.3	-0.4	0.4
03:00	25.0	25.0	26.2	26.8	24.3	23.5	85.2	-0.3	-0.5	0.6
03:30	25.0	25.0	26.0	26.4	24.4	23.7	87.0	-0.1	-0.4	0.7
04:00	24.6	24.6	25.7	25.9	24.1	23.5	87.8	-0.3	-0.4	0.7
04:30	24.6	24.6	25.6	25.8	24.1	23.5	88.1	-0.2	-0.4	0.5
05:00	24.5	24.4	25.3	25.8	23.9	23.3	88.6	-0.3	-0.5	0.6
05:30	24.7	24.7	25.7	26.5	24.0	23.3	86.7	-0.2	-0.4	0.3
06:00	25.2	25.1	26.2	27.4	24.3	23.6	85.7	-0.2	-0.3	-0.1
06:30	26.1	25.8	27.1	29.9	24.5	23.4	80.4	-0.3	-0.4	0.1
07:00	26.3	26.0	27.8	30.4	24.5	23.2	75.9	-0.2	-0.3	0.3
平均		25.84	28.05				76.46	-0.25	-0.42	0.32

高さによる差分(平均値)					高さによる平均値			
		H=1500	H=1000	H=500	H=1500	H=1000	H=500	平均値
既設部	WBGT (°C)	-0.25	-0.40		25.84	26.09	26.49	26.14
	気温 (°C)	-0.42	-0.14		28.05	28.47	28.61	28.38
	湿度 (%)	0.32	-2.36		76.46	76.14	78.50	77.03
施工部	WBGT (°C)	-0.38	0.10		25.93	26.31	26.21	26.15
	気温 (°C)	-0.36	-0.03		27.93	28.28	28.32	28.18
	湿度 (%)	-1.78	1.61		78.41	80.18	78.58	79.06

測定箇所 歩道部A (既設部)

測定器No No. 2 H=1000

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)	H=500との差		
	WBGT IN (°C)	WBGT OUT (°C)						WBGT OUT (°C)	気温 (°C)	相対湿度 (°C)
17:00	29.1	29.0	34.5	35.2	26.5	23.2	52.0	-0.5	-0.1	-2.2
17:30	28.7	28.6	34.2	35.0	26.0	22.6	51.0	-0.6	-0.2	-2.4
18:00	28.1	28.1	32.4	32.9	26.1	23.6	60.0	-0.4	-0.2	-1.7
18:30	27.7	27.7	31.7	31.8	26.0	23.8	62.9	-0.4	-0.2	-2.1
19:00	27.5	27.5	31.2	30.9	26.0	23.9	65.2	-0.3	-0.1	-2.1
19:30	27.0	27.1	30.4	30.2	25.7	23.8	68.0	-0.3	-0.1	-2.1
20:00	26.7	26.7	29.8	29.7	25.4	23.7	69.9	-0.5	-0.2	-2.3
20:30	26.6	26.6	29.2	28.9	25.6	24.2	74.6	-0.4	-0.1	-2.1
21:00	26.5	26.5	29.5	29.2	25.3	23.7	71.2	-0.6	-0.3	-1.9
21:30	26.2	26.2	28.8	28.7	25.1	23.6	73.7	-0.4	-0.2	-2.2
22:00	26.2	26.2	28.9	28.8	25.1	23.6	73.0	-0.4	-0.1	-2.5
22:30	26.1	26.1	28.8	28.6	25.0	23.4	72.7	-0.3	-0.1	-2.4
23:00	25.8	25.9	28.1	27.8	25.0	23.8	77.4	-0.3	0.0	-2.4
23:30	25.8	25.8	27.9	27.6	25.0	23.8	78.4	-0.4	-0.2	-2.1
00:00	25.6	25.6	27.8	27.6	24.7	23.5	77.4	-0.4	-0.1	-2.4
00:30	25.1	25.2	26.8	26.6	24.5	23.6	82.7	-0.2	0.0	-3.2
01:00	25.0	25.1	26.8	26.3	24.5	23.6	82.8	-0.4	-0.1	-2.8
01:30	25.0	25.0	26.6	26.2	24.5	23.7	84.2	-0.5	-0.1	-2.4
02:00	25.1	25.1	26.6	26.4	24.5	23.7	84.0	-0.5	-0.2	-2.7
02:30	25.1	25.2	26.5	26.4	24.6	23.8	85.2	-0.4	-0.2	-2.4
03:00	25.3	25.3	26.7	26.6	24.7	23.9	84.6	-0.4	-0.2	-2.1
03:30	25.1	25.1	26.4	26.2	24.6	23.9	86.3	-0.4	-0.2	-2.1
04:00	24.9	24.9	26.1	25.7	24.5	23.8	87.1	-0.3	0.0	-2.7
04:30	24.8	24.8	26.0	25.6	24.4	23.8	87.6	-0.3	-0.1	-2.4
05:00	24.7	24.7	25.8	25.6	24.3	23.7	88.0	-0.3	-0.1	-2.2
05:30	24.9	24.9	26.1	26.3	24.3	23.6	86.4	-0.5	-0.3	-2.3
06:00	25.4	25.3	26.5	27.3	24.6	23.9	85.8	-0.4	-0.1	-2.9
06:30	26.3	26.1	27.5	29.8	24.8	23.8	80.3	-0.4	-0.1	-2.9
07:00	26.4	26.2	28.1	30.3	24.8	23.4	75.6	-0.4	-0.2	-2.5
平均		26.09	28.47			平均	76.14	-0.40	-0.14	-2.36

測定箇所 歩道部A (既設部)

測定器No No. 3 H=500

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)
	WBGT IN (°C)	WBGT OUT (°C)					
17:00	29.6	29.5	34.6	35.5	27.0	24.0	54.2
17:30	29.2	29.2	34.4	35.2	26.7	23.6	53.4
18:00	28.6	28.5	32.6	33.1	26.6	24.3	61.7
18:30	28.2	28.1	31.9	32.0	26.5	24.5	65.0
19:00	27.8	27.8	31.3	31.1	26.4	24.5	67.3
19:30	27.4	27.4	30.5	30.5	26.1	24.4	70.1
20:00	27.2	27.2	30.0	29.9	26.0	24.4	72.2
20:30	27.0	27.0	29.3	29.2	26.0	24.8	76.7
21:00	27.0	27.1	29.8	29.4	26.0	24.5	73.1
21:30	26.6	26.6	29.0	28.9	25.6	24.3	75.9
22:00	26.6	26.6	29.0	29.0	25.5	24.2	75.5
22:30	26.4	26.4	28.9	28.8	25.4	24.0	75.1
23:00	26.2	26.2	28.1	28.1	25.4	24.3	79.8
23:30	26.1	26.2	28.1	27.8	25.4	24.4	80.5
00:00	25.9	26.0	27.9	27.7	25.2	24.1	79.8
00:30	25.4	25.4	26.8	26.7	24.9	24.2	85.9
01:00	25.4	25.5	26.9	26.4	25.0	24.3	85.6
01:30	25.4	25.5	26.7	26.4	25.0	24.3	86.6
02:00	25.6	25.6	26.8	26.6	25.1	24.4	86.7
02:30	25.6	25.6	26.7	26.6	25.1	24.5	87.6
03:00	25.7	25.7	26.9	26.8	25.2	24.5	86.7
03:30	25.5	25.5	26.6	26.4	25.1	24.5	88.4
04:00	25.1	25.2	26.1	25.9	24.8	24.3	89.8
04:30	25.1	25.1	26.1	25.8	24.8	24.3	90.0
05:00	25.0	25.0	25.9	25.8	24.7	24.2	90.2
05:30	25.4	25.4	26.4	26.5	25.0	24.4	88.7
06:00	25.8	25.7	26.6	27.4	25.1	24.6	88.7
06:30	26.8	26.5	27.6	30.0	25.4	24.5	83.2
07:00	26.8	26.6	28.3	30.4	25.3	24.1	78.1
平均	26.49	28.61				平均	78.50

測定箇所 歩道部A (施工部)

測定器No No. 4 H=1500

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)	H=1000との差		
	WBGT IN (°C)	WBGT OUT (°C)						WBGT OUT (°C)	気温 (°C)	相対湿度 (°C)
17:00	29.0	28.9	34.0	35.4	26.3	23.2	53.5	-0.3	-0.3	-1.0
17:30	28.9	28.7	33.7	35.6	26.0	22.8	53.0	-0.2	-0.3	-1.1
18:00	28.0	27.9	31.8	32.9	25.9	23.6	61.8	-0.3	-0.4	-1.1
18:30	27.6	27.5	31.0	31.8	25.8	23.7	65.2	-0.3	-0.3	-1.3
19:00	27.4	27.3	30.6	31.0	25.8	23.9	67.5	-0.4	-0.4	-1.1
19:30	26.9	26.9	29.8	30.2	25.5	23.8	70.1	-0.4	-0.4	-1.6
20:00	26.8	26.7	29.4	29.7	25.5	23.9	72.3	-0.3	-0.3	-1.5
20:30	26.6	26.5	28.7	29.0	25.5	24.2	76.9	-0.4	-0.3	-1.6
21:00	26.4	26.4	28.8	29.2	25.2	23.7	74.2	-0.4	-0.4	-1.5
21:30	26.1	26.1	28.4	28.8	25.0	23.7	75.6	-0.4	-0.4	-1.8
22:00	26.1	26.1	28.4	28.8	25.0	23.6	75.2	-0.4	-0.4	-1.9
22:30	26.0	25.9	28.3	28.7	24.8	23.4	75.0	-0.5	-0.4	-1.6
23:00	25.8	25.7	27.5	28.0	24.8	23.7	79.8	-0.4	-0.3	-1.8
23:30	25.6	25.6	27.3	27.8	24.7	23.6	80.1	-0.3	-0.3	-2.0
00:00	25.5	25.5	27.3	27.6	24.6	23.5	79.7	-0.4	-0.4	-1.8
00:30	25.2	25.1	26.5	26.9	24.4	23.6	84.0	-0.4	-0.3	-2.4
01:00	25.0	25.0	26.3	26.5	24.4	23.6	84.9	-0.4	-0.4	-1.9
01:30	24.9	24.8	25.9	26.2	24.3	23.7	87.6	-0.5	-0.4	-1.8
02:00	25.0	24.9	25.9	26.3	24.4	23.8	88.0	-0.4	-0.4	-2.0
02:30	25.1	25.1	26.1	26.5	24.5	23.8	87.2	-0.4	-0.4	-2.1
03:00	25.2	25.1	26.2	26.7	24.5	23.8	86.8	-0.4	-0.3	-2.0
03:30	25.0	25.0	25.9	26.3	24.5	23.9	88.8	-0.3	-0.3	-2.2
04:00	24.6	24.6	25.5	25.8	24.1	23.5	88.8	-0.4	-0.4	-2.3
04:30	24.6	24.5	25.4	25.6	24.1	23.6	89.8	-0.5	-0.4	-2.3
05:00	24.6	24.5	25.3	25.7	24.1	23.6	90.3	-0.5	-0.3	-2.2
05:30	24.9	24.9	25.7	26.4	24.3	23.7	88.6	-0.3	-0.3	-2.1
06:00	25.3	25.2	26.0	27.3	24.5	23.9	88.0	-0.4	-0.3	-2.0
06:30	25.9	25.7	26.7	28.9	24.6	23.7	83.5	-0.3	-0.4	-1.8
07:00	26.1	25.8	27.5	30.0	24.4	23.2	77.6	-0.5	-0.4	-1.7
平均		25.93	27.93			平均	78.41	-0.38	-0.36	-1.78

測定箇所 歩道部A (施工部)

測定器No No. 5 H=1000

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)	H=500との差		
	WBGT IN (°C)	WBGT OUT (°C)						WBGT OUT (°C)	気温 (°C)	相対湿度 (°C)
17:00	29.3	29.2	34.3	35.2	26.8	23.8	54.5	0.0	0.0	0.0
17:30	29.0	28.9	34.0	35.2	26.4	23.4	54.1	0.0	0.0	0.1
18:00	28.3	28.2	32.2	32.7	26.4	24.2	62.9	-0.2	-0.2	0.8
18:30	27.8	27.8	31.3	31.6	26.2	24.3	66.5	0.0	0.0	0.6
19:00	27.6	27.7	31.0	30.8	26.3	24.5	68.6	0.1	0.0	0.6
19:30	27.3	27.3	30.2	30.1	26.1	24.5	71.7	0.1	0.0	1.1
20:00	27.0	27.0	29.7	29.6	25.9	24.5	73.8	0.0	0.0	1.0
20:30	26.9	26.9	29.0	28.9	26.0	24.9	78.5	0.2	0.0	1.4
21:00	26.8	26.8	29.2	29.0	25.8	24.5	75.7	0.2	0.0	1.4
21:30	26.5	26.5	28.8	28.7	25.6	24.4	77.4	0.1	0.0	1.5
22:00	26.5	26.5	28.8	28.7	25.6	24.4	77.1	0.1	0.0	1.5
22:30	26.4	26.4	28.7	28.5	25.5	24.2	76.6	0.1	0.0	1.2
23:00	26.0	26.1	27.8	27.8	25.3	24.4	81.6	0.2	0.0	1.5
23:30	25.9	25.9	27.6	27.6	25.2	24.3	82.1	0.0	-0.1	1.5
00:00	25.9	25.9	27.7	27.4	25.2	24.2	81.5	0.1	0.0	1.6
00:30	25.5	25.5	26.8	26.6	25.0	24.3	86.4	0.1	0.0	1.8
01:00	25.4	25.4	26.7	26.3	25.0	24.3	86.8	0.1	0.0	1.8
01:30	25.2	25.3	26.3	26.0	24.9	24.4	89.4	0.2	0.0	2.4
02:00	25.3	25.3	26.3	26.1	25.0	24.5	90.0	0.2	0.0	2.4
02:30	25.5	25.5	26.5	26.3	25.1	24.6	89.3	0.2	0.0	1.9
03:00	25.5	25.5	26.5	26.4	25.1	24.5	88.8	0.2	0.0	2.1
03:30	25.3	25.3	26.2	26.1	25.0	24.6	91.0	0.1	0.0	2.1
04:00	25.0	25.0	25.9	25.6	24.7	24.3	91.1	0.1	0.0	2.2
04:30	25.0	25.0	25.8	25.5	24.8	24.4	92.1	0.2	0.0	2.3
05:00	24.9	25.0	25.6	25.5	24.7	24.3	92.5	0.3	0.0	2.2
05:30	25.2	25.2	26.0	26.2	24.8	24.4	90.7	0.1	0.0	2.1
06:00	25.6	25.6	26.3	27.1	25.0	24.5	90.0	0.2	-0.1	2.5
06:30	26.2	26.0	27.1	28.7	25.1	24.4	85.3	-0.1	-0.3	2.8
07:00	26.5	26.3	27.9	29.8	25.1	24.0	79.3	0.0	-0.3	2.2
平均		26.31	28.28			平均	80.18	0.10	-0.03	1.61

測定箇所 歩道部A (施工部)

測定器No No. 6 H=500

測定日 R1. 7. 29

測定時間	暑さ指数		気温 (°C)	黒球温度 (°C)	湿球温度 (°C)	露点 (°C)	相対湿度 (%)
	WBGT IN (°C)	WBGT OUT (°C)					
17:00	29.3	29.2	34.3	35.2	26.8	23.8	54.5
17:30	29.1	28.9	34.0	35.3	26.4	23.4	54.0
18:00	28.4	28.4	32.4	32.8	26.5	24.2	62.1
18:30	27.8	27.8	31.3	31.7	26.2	24.2	65.9
19:00	27.6	27.6	31.0	30.9	26.2	24.4	68.0
19:30	27.2	27.2	30.2	30.1	25.9	24.3	70.6
20:00	26.9	27.0	29.7	29.6	25.8	24.3	72.8
20:30	26.7	26.7	29.0	28.9	25.8	24.6	77.1
21:00	26.6	26.6	29.2	29.0	25.6	24.2	74.3
21:30	26.4	26.4	28.8	28.7	25.4	24.1	75.9
22:00	26.4	26.4	28.8	28.7	25.4	24.1	75.6
22:30	26.3	26.3	28.7	28.5	25.3	23.9	75.4
23:00	25.9	25.9	27.8	27.8	25.1	24.1	80.1
23:30	25.8	25.9	27.7	27.6	25.1	24.1	80.6
00:00	25.7	25.8	27.7	27.4	25.0	23.9	79.9
00:30	25.4	25.4	26.8	26.7	24.8	24.0	84.6
01:00	25.3	25.3	26.7	26.4	24.8	24.0	85.0
01:30	25.0	25.1	26.3	26.1	24.6	24.0	87.0
02:00	25.1	25.1	26.3	26.1	24.7	24.1	87.6
02:30	25.2	25.3	26.5	26.3	24.8	24.2	87.4
03:00	25.3	25.3	26.5	26.5	24.8	24.1	86.7
03:30	25.2	25.2	26.2	26.1	24.8	24.2	88.9
04:00	24.9	24.9	25.9	25.7	24.5	23.9	88.9
04:30	24.8	24.8	25.8	25.5	24.5	24.0	89.8
05:00	24.7	24.7	25.6	25.5	24.4	23.9	90.3
05:30	25.1	25.1	26.0	26.2	24.6	24.0	88.6
06:00	25.5	25.4	26.4	27.2	24.8	24.2	87.5
06:30	26.2	26.1	27.4	28.8	25.1	24.2	82.5
07:00	26.5	26.3	28.2	30.0	25.0	23.8	77.1
平均	26.21	28.32				平均	78.58

項目番号	1	測定箇所	歩道部A	(既設部)
製造番号	180533285	測定器No	No. 1-上	H=1000
機種コメント	LR5041	測定日時	R1. 7. 29	
CHコメント	CH1			
属性	瞬時値			
単位	mV			
平均	6.32			
最大	14.92			
最小	0.01			
積算	157.9			

測定時間	測定値 (mV)	計算値および固有値			
		電圧	感度	日射量	アルベド値
		U (μ v)	S (μ v/(W/m ²))	Eu (W/m ²)	EI/Eu
17:00	0.59	590	14.86	40	0.125
17:30	1.04	1040	14.86	70	0.114
18:00	0.60	600	14.86	40	0.125
18:30	0.31	310	14.86	21	0.190
19:00	-0.02	-20	14.86	-1	-2.000
19:30	-0.05	-50	14.86	-3	-0.333
20:00	-0.06	-60	14.86	-4	-0.250
20:30	-0.06	-60	14.86	-4	-0.250
21:00	-0.04	-40	14.86	-3	-0.333
21:30	-0.06	-60	14.86	-4	-0.250
22:00	-0.04	-40	14.86	-3	-0.333
22:30	-0.04	-40	14.86	-3	-0.333
23:00	-0.05	-50	14.86	-3	-0.333
23:30	-0.05	-50	14.86	-3	-0.333
00:00	-0.04	-40	14.86	-3	-0.333
00:30	-0.07	-70	14.86	-5	0.000
01:00	-0.06	-60	14.86	-4	-0.500
01:30	-0.06	-60	14.86	-4	-0.250
02:00	-0.04	-40	14.86	-3	-0.333
02:30	-0.04	-40	14.86	-3	-0.333
03:00	-0.03	-30	14.86	-2	-0.500
03:30	-0.03	-30	14.86	-2	-0.500
04:00	-0.06	-60	14.86	-4	-0.250
04:30	-0.05	-50	14.86	-3	-0.667
05:00	0.01	10	14.86	1	1.000
05:30	0.30	300	14.86	20	0.150
06:00	0.77	770	14.86	52	0.115
06:30	2.60	2600	14.86	175	0.137
07:00	1.96	1960	14.86	132	0.098

平均値

-0.328

項目番号	1	測定箇所	歩道部A	(既設部)
製造番号	180533284	測定器No	No. 1-下	H=1000
機種コメント	LR5041	測定日時	R1. 7. 29	
CHコメント	CH1			
属性	瞬時値			
単位	mV			
平均	0.55			
最大	1.24			
最小	0.03			
積算	13.83			

測定時間	測定値 (mV)	計算値および固有値		
		電圧	感度	日射量
		U (μV)	S (μV/(W/m ²))	EI (W/m ²)
17:00	0.07	70	15.00	5
17:30	0.12	120	15.00	8
18:00	0.08	80	15.00	5
18:30	0.06	60	15.00	4
19:00	0.03	30	15.00	2
19:30	0.02	20	15.00	1
20:00	0.02	20	15.00	1
20:30	0.01	10	15.00	1
21:00	0.02	20	15.00	1
21:30	0.02	20	15.00	1
22:00	0.02	20	15.00	1
22:30	0.02	20	15.00	1
23:00	0.01	10	15.00	1
23:30	0.02	20	15.00	1
00:00	0.02	20	15.00	1
00:30	0.00	0	15.00	0
01:00	0.03	30	15.00	2
01:30	0.02	20	15.00	1
02:00	0.02	20	15.00	1
02:30	0.02	20	15.00	1
03:00	0.02	20	15.00	1
03:30	0.02	20	15.00	1
04:00	0.02	20	15.00	1
04:30	0.03	30	15.00	2
05:00	0.02	20	15.00	1
05:30	0.05	50	15.00	3
06:00	0.09	90	15.00	6
06:30	0.36	360	15.00	24
07:00	0.20	200	15.00	13

項目番号	3	測定箇所	歩道部A	(施工部)
製造番号	180533286	測定器No	No. 2-上	H=1000
機種コメント	LR5041	測定日時	R1. 7. 29	
CHコメント	CH1			
属性	瞬時値			
単位	mV			
平均	7.55			
最大	15.73			
最小	0.02			
積算	188.72			


















































測定時間	測定値 (mV)	計算値および固有値			
		電圧	感度	日射量	アルベド値
		U (μ v)	S (μ v/(W/m ²))	Eu (W/m ²)	EI/Eu
17:00	0.61	610	15.78	39	0.205
17:30	1.13	1130	15.78	72	0.194
18:00	0.57	570	15.78	36	0.194
18:30	0.30	300	15.78	19	0.263
19:00	-0.01	-10	15.78	-1	-1.000
19:30	-0.04	-40	15.78	-3	-0.333
20:00	-0.04	-40	15.78	-3	-0.333
20:30	-0.05	-50	15.78	-3	0.000
21:00	-0.03	-30	15.78	-2	-0.500
21:30	-0.04	-40	15.78	-3	-0.333
22:00	-0.04	-40	15.78	-3	-0.333
22:30	-0.03	-30	15.78	-2	-0.500
23:00	-0.04	-40	15.78	-3	0.000
23:30	-0.03	-30	15.78	-2	-0.500
00:00	-0.04	-40	15.78	-3	-0.333
00:30	-0.06	-60	15.78	-4	0.000
01:00	-0.05	-50	15.78	-3	-0.333
01:30	-0.04	-40	15.78	-3	-0.333
02:00	-0.03	-30	15.78	-2	-0.500
02:30	-0.03	-30	15.78	-2	-0.500
03:00	-0.02	-20	15.78	-1	-1.000
03:30	-0.03	-30	15.78	-2	-0.500
04:00	-0.04	-40	15.78	-3	-0.333
04:30	-0.04	-40	15.78	-3	-0.333
05:00	0.03	30	15.78	2	1.000
05:30	0.33	330	15.78	21	0.238
06:00	0.81	810	15.78	51	0.196
06:30	1.68	1680	15.78	106	0.217
07:00	2.15	2150	15.78	136	0.191























































平均値
























































-0.343





































項目番号	1	測定箇所	歩道部A	(施工部)
製造番号	180533283	測定器No	No. 2-下	H=1000
機種コメント	LR5041	測定日時	R1. 7. 29	
CHコメント	CH1			
属性	瞬時値			
単位	mV			
平均	2.07			
最大	4.35			
最小	0			
積算	51.65			

測定時間	測定値 (mV)	計算値および固有値		
		電圧	感度	日射量
		U (μV)	S (μV/(W/m ²))	E (W/m ²)
17:00	0.13	130	16.68	8
17:30	0.24	240	16.68	14
18:00	0.12	120	16.68	7
18:30	0.08	80	16.68	5
19:00	0.02	20	16.68	1
19:30	0.01	10	16.68	1
20:00	0.01	10	16.68	1
20:30	0.00	0	16.68	0
21:00	0.01	10	16.68	1
21:30	0.01	10	16.68	1
22:00	0.01	10	16.68	1
22:30	0.01	10	16.68	1
23:00	0.00	0	16.68	0
23:30	0.01	10	16.68	1
00:00	0.02	20	16.68	1
00:30	0.00	0	16.68	0
01:00	0.01	10	16.68	1
01:30	0.01	10	16.68	1
02:00	0.02	20	16.68	1
02:30	0.02	20	16.68	1
03:00	0.01	10	16.68	1
03:30	0.01	10	16.68	1
04:00	0.01	10	16.68	1
04:30	0.02	20	16.68	1
05:00	0.03	30	16.68	2
05:30	0.08	80	16.68	5
06:00	0.17	170	16.68	10
06:30	0.38	380	16.68	23
07:00	0.43	430	16.68	26

測定時間	風速 (m/s)	路面温度(赤外線サーモグラフィによる測定)										備考		
		No. 1 既設 Data. No	No. 2 境界部 Data. No	No. 3 対策済 Data. No	No. 1 既設部 路面温度(℃)		No. 2 境界部 路面温度(℃)		No. 3 施工部 路面温度(℃)		温度差 (℃)			
17:00	0.5	11, 12	13, 14	15, 16	 44.0	 43.2	 42.5	 40.7	 38.2	 38.2	 39.8	 38.8	4.2	
17:30	0.2	19, 20	22, 23	24, 25	 42.8	 42.6	 41.6	 40.2	 41.4	 38.2	 39.1	 37.6	3.7	
18:00	1.2	27, 28	30, 31	32, 33	 41.1	 40.2	 39.3	 37.7	 39.3	 34.4	 36.3	 35.0	4.8	
18:30	0.3	35, 36	38, 39	40, 41	 39.4	 38.7	 37.9	 36.0	 37.6	 35.5	 35.2	 33.5	4.2	
19:00	0.9	43, 44	46, 47	48, 49	 38.0	 38.4	 37.1	 35.7	 33.7	 34.8	 34.4	 33.2	3.6	
19:30	0.9	51, 52	54, 55	56, 57	 37.4	 37.3	 36.5	 35.0	 36.1	 32.9	 33.7	 32.7	3.7	
20:00	0.0	59, 60	62, 63	64, 65	 36.8	 36.1	 35.5	 33.9	 35.3	 32.4	 32.9	 32.9	3.9	

測定 時間	風速 (m/s)	路面温度(赤外線サーモグラフィによる測定)										温度差 (℃)	備 考
		No. 1 既設 Data. No	No. 2 境界部 Data. No	No. 3 対策済 Data. No	No. 1 既設部 路面温度(℃)		No. 2 境界部 路面温度(℃)		No. 3 施工部 路面温度(℃)				
20:30	0.8	67, 68	70, 71	72, 73	 36.0	 35.8	 34.7	 33.5	 34.7	 31.7	 32.7	 32.4	
21:00	0.6	75, 76	78, 79	80, 81	 36.0	 35.2	 34.7	 33.5	 34.5	 32.0	 32.4	 32.0	
21:30	0.5	83, 84	86, 87	88, 89	 35.3	 35.0	 34.2	 32.9	 33.7	 31.5	 32.4	 31.2	
22:00	0.5	91, 92	94, 95	96, 97	 35.3	 34.8	 33.7	 32.7	 34.0	 31.5	 32.2	 31.5	
22:30	0.3	99, 100	102, 103	104, 105	 34.8	 34.4	 33.5	 32.4	 33.9	 31.7	 31.5	 31.0	
23:00	0.3	107, 108	110, 111	112, 113	 34.4	 34.2	 33.5	 32.0	 32.9	 29.3	 30.7	 30.2	
23:30	0.8	115, 116	118, 119	120, 121	 33.7	 33.4	 33.5	 31.0	 32.4	 30.4	 30.7	 29.7	
0:00	0.1	123, 124	126, 127	128, 129	 33.2	 33.4	 32.9	 31.4	 32.5	 30.2	 30.0	 29.9	

測定 時間	風速 (m/s)	路面温度(赤外線サーモグラフィによる測定)										備考	
		No. 1 既設 Data. No	No. 2 境界部 Data. No	No. 3 対策済 Data. No	No. 1 既設部 路面温度(°C)		No. 2 境界部 路面温度(°C)		No. 3 施工部 路面温度(°C)		温度差 (°C)		
0:30	0.0	131, 132	134, 135	136, 137	 33.0	 32.7	 32.4	 30.9	 32.2	 30.4	 30.0	 29.7	
1:00	0.0	139, 140	142, 143	144, 145	 32.8	 32.2	 32.0	 30.5	 31.9	 30.2	 29.7	 29.9	
1:30	0.3	147, 148	150, 151	152, 153	 32.7	 32.2	 31.2	 30.0	 31.7	 29.3	 29.7	 29.7	
2:00	0.0	155, 156	158, 159	160, 161	 32.4	 32.5	 32.0	 30.7	 31.9	 29.7	 29.5	 29.7	
2:30	0.0	163, 164	166, 167	168, 169	 32.4	 32.5	 31.4	 30.5	 31.7	 29.5	 30.2	 29.3	
3:00	0.0	171, 172	174, 175	176, 177	 32.4	 32.5	 31.5	 30.5	 32.0	 29.5	 30.0	 29.9	
3:30	0.0	179, 180	182, 183	184, 185	 32.2	 32.4	 31.2	 30.2	 31.2	 30.0	 29.7	 29.5	
4:00	0.0	187, 188	190, 191	192, 193	 31.2	 31.2	 30.2	 29.2	 30.0	 28.3	 29.0	 29.0	

測定 時間	風速 (m/s)	路面温度(赤外線サーモグラフィによる測定)										備 考
		No. 1 既設 Data. No	No. 2 境界部 Data. No	No. 3 対策済 Data. No	No. 1 既設部 路面温度(°C)		No. 2 境界部 路面温度(°C)		No. 3 施工部 路面温度(°C)		温度差 (°C)	
4:30	0.0	195, 196	198, 199	200, 201	 31.2	 31.4	 30.4	 28.8	 28.5	 28.3	2.7	
5:00	0.0	203, 204	206, 207	208, 209	 31.4	 31.2	 30.2	 29.2	 30.4	 28.3	2.6	
5:30	0.0	211, 212	214, 215	216, 217	 31.5	 31.7	 30.5	 29.5	 30.9	 29.9	2.3	
6:00	0.0	219, 220	222, 223	224, 225	 32.2	 32.2	 31.5	 30.2	 31.4	 29.5	2.7	
6:30	0.0	227, 228	230, 231	232, 233	 32.4	 32.2	 31.7	 30.2	 31.7	 29.5	2.5	
7:00	0.0	235, 236	238, 239	240, 241	 33.5	 33.4	 32.4	 31.2	 32.9	 30.2	2.8	
平均温度					34.8						3.1	